



## Bid Notice Abstract

### Request for Quotation (RFQ)

**Reference Number** 12223478  
**Procuring Entity** DEVELOPMENT BANK OF THE PHILIPPINES - BBG - NORTHERN MINDANAO  
**Title** SUPPLY, DELIVERY, INSTALLATION, TESTING AND COMMISSIONING OF BURGLAR ALARM SYSTEM  
**Area of Delivery** Misamis Oriental

<b>Solicitation Number:</b>	2025 VIL 009	<b>Status</b>	In-Preparation
<b>Trade Agreement:</b>	Implementing Rules and Regulations		
<b>Procurement Mode:</b>	Negotiated Procurement - Small Value Procurement (Sec. 53.9)	<b>Associated Components</b>	4
<b>Classification:</b>	Goods - General Support Services	<b>Bid Supplements</b>	0
<b>Category:</b>	Security Surveillance and Detection Equipment		
<b>Approved Budget for the Contract:</b>	PHP 229,470.59	<b>Document Request List</b>	0
<b>Delivery Period:</b>	30 Day/s		
<b>Client Agency:</b>		<b>Date Published</b>	16/07/2025
<b>Contact Person:</b>	Richele S. Joloyohoy BAC Secretariat Tirso Neri St. corner Corrales Ave. Cagayan De Oro City Misamis Oriental Philippines 9000 63-088-8572088 nmbg@dbp.ph	<b>Last Updated / Time</b>	15/07/2025 08:57 AM
		<b>Closing Date / Time</b>	22/07/2025 15:00 PM
<b>Description</b>  Kindly refer to attached Technical Specifications, Layout and Bill of Quantities. <b>Other Information</b> For additional information, please look for Mr. Windyl Kart M. Salapang (Branch Services Officer)			

**Created by** Richele S. Joloyohoy  
**Date Created** 15/07/2025

The PhilGEPS team is not responsible for any typographical errors or misinformation presented in the system. PhilGEPS only displays information provided for by its clients, and any queries regarding the postings should be directed to the contact person/s of the concerned party.





Development Bank of the Philippines

## REQUEST FOR QUOTATION

Date of Posting/Canvass : **Tuesday, July 15, 2025**  
Date of Last Submission : **Tuesday, July 22, 2025**  
Solicitation Number : 2025 VIL 009  
Procuring Entity : DBP Villanueva Branch  
Title : **SUPPLY, DELIVERY, INSTALLATION, TESTING AND COMMISSIONING OF BURGLAR ALARM SYSTEM**  
Area of Delivery : NVCDC Building, National Highway, Brgy. Katipunan, Mun. of Villanueva, Misamis Oriental 9002  
Procurement Mode : Negotiated Procurement - Small Value Procurement (Sec. 53.9)  
Classification : Goods - General Support Services  
Category : Security Surveillance and Detection Equipment  
Approved Budget : **229,470.59**  
Delivery Period : **30 days**

Item No.	Item and Description	Quantity	Unit/s	Unit Price	Total Price
1	<b>Supply, Delivery, Installation, Testing and Commissioning of Burglar Alarm System</b> (kindly refer to attached Technical Specifications, Layout and Bill of Quantities)	1	Lot		
	***NOTHING FOLLOWS***				
	<b>Total Amount</b>				

Please quote your lowest price on the item/s stated above, subject to the general conditions below.

(Sgd.) **AM WILFRED ANTONIO P. KAAMIÑO**  
Branch Head

After having carefully read and accepted your general conditions, I/We quote you on the item(s) at prices noted above.

### General Conditions & Requirements:

- All Entries must be typewritten/legibly written
  - Price quotation must be based on the Technical Specifications (TS), Terms of Reference (TOR) / Scope of Work/Services (SOW), as applicable and must be duly signed by the supplier's representative.
  - Price quotation (Unit Cost) must be inclusive of VAT and other applicable taxes/charges.
  - Price offered shall not be subject to any increase for whatever reason including in cases of devaluation/inflation during the entire duration of the contract
  - Price quotation with incomplete documentary requirement shall not be considered for evaluation.
  - Signed copy of this RFQ by the supplier's authorized representative should be attached with the submitted proposal.
  - Partial bids are allowed.
  - Mode of submission of quotation: Open.
- Quotation must include the documentary requirements below:
- ☐ Proof of PhilGEPS Registration;
  - ☐ Mayor's/Business permit for the current year;
  - ☐ Omnibus Sworn Statement (For ABC's above P50K); Secretary's Certificate (If Partnership/Corporation)
  - ☐ Business/Income Tax Return (For ABC's above P500K);
  - ☐ Samples/Brochure/Data Sheet, as necessary and/or other documents as specified in the TOR/SOW/TS;
  - ☐ Statement of Government &/or Private Contracts Completed which are Similar in Nature
- No down-payment or advanced payment.
  - Payment shall be processed after completion of delivery, subject to complete documents for payment (i.e) Billing/ Statement of Account).
  - For every day of delivery delay, 1/10 of 1% of the price of the undelivered quantity shall be deducted from the payment.
  - DBP has the right to reject delivery if item/s delivered were found to be defective and/or not according to the required specifications.

Printed Name/Signature

Tel.No./Cell No./e-mail Address

Company Name

Address

Date:

TIN #:

(Indicate if VAT or VAT exempt)



**DEVELOPMENT BANK OF THE PHILIPPINES (DBP)**  
**TECHNICAL SPECIFICATIONS**

Supply, Delivery, Installation, Testing & Commissioning of  
**Burglar Alarm System**  
Small Value Procurement

- I. **Approved Budget for the Contract:** ₱ 229,470.59 (inclusive of VAT/applicable taxes and other charges)
- II. **Scope of Works and Technical Specifications:** (per attached Annex A)
- III. **Conditions of the Contract:**
  1. The Contractor shall ensure that the items delivered are in accordance with the specifications required by the DBP. DBP has the right to reject the delivery if item/s delivered were found to be defective and not according to the required specifications.
  2. The Contractor shall submit construction schedule reflecting all activities needed to complete the project, their sequence and duration.
  3. The Contractor must submit sample/s of materials and devices for approval by DBP before installation.
  4. The Contractor shall designate or employ a full-time project coordinator that will supervise on-site works and activities.
  5. DBP may terminate/cancel the Purchase Order (PO) / Notice to Proceed (NTP) when the Contractor fails to deliver, perform, and comply with its obligation.
  6. **Project Period:** The Contractor shall complete the project within thirty (30) calendar days after receipt of Purchase Order (PO) / Notice to Proceed (NTP).
  7. **Point of Delivery:**

Address	Contact No.	No. of Lots
DBP Villanueva Branch NVCDC Building, National Highway Brgy. Katipunan, Mun. of Villanueva Misamis Oriental 9002  Email: villanueva@dbp.ph	(088) 890 4769	1



## **VI. Liquidated Damages:**

1. Once the contract duration expires, including any time extension duly granted, and the Supplier refuses or fails to satisfactorily complete the work, DBP shall impose upon the Contractor in default liquidated damages. Liquidated damage is an amount equal to at least one tenth (1/10) of one (1) percent of the cost of the unperformed portion of the works for every day of delay.
2. In case the total sum of liquidated damages reaches ten percent (10%) of the total contract price, DBP may terminate the contract or allow the contractor to continue the works without prejudice to the continued imposition of liquidated damages until the works have been completed. This does not, however, preclude DBP in resorting to Termination of Contract under Annex I of the 2016 revised IRR of RA No. 9184.

Prepared by:

(signed)  
**WINDYL KART M. SALAPANG**  
Branch Services Officer

Approved by:

(signed)  
**AM WILFRED ANTONIO P. KAAMIÑO**  
Head, Villanueva Branch



SUPPLY, DELIVERY, INSTALLATION AND TESTING & COMMISSIONING OF BURGLAR ALARM SYSTEM FOR DBP VILLANUEVA BRANCH

Project Name  
KATIPUNAN HIGHWAY, VILLANUEVA, MISAMIS ORIENTAL  
Project Location

**BILL OF QUANTITIES**

ITEM NO.	DESCRIPTION	QTY.	UNIT
<b>1</b>	<b>GENERAL REQUIREMENTS</b>		
1.1	Mobilization and demobilization	1	lot
1.2	Health and safety	1	lot
1.3	Hauling/disposal	1	lot
<b>2</b>	<b>ELECTRICAL</b>		
2.1	Dismantling of Existing Burglar Alarm System including Burglar Alarm Control Panel, Devices, Conduits and Wires	1	lot
2.2	<b>Burglar Alarm System and Accessories</b>		
2.2.1	Burglar alarm control panel	1	set/s
2.2.2	Auto dialer for burglar alarm	1	set/s
2.2.3	Siren with strobelights	1	set/s
2.2.4	Magnetic door contact	9	pc/s
2.2.5	Hold-up buttons	14	set/s
2.2.6	Foot rail switches	3	set/s
2.2.7	Money clip	3	pc/s
2.2.8	Vibration contact	14	set/s
2.2.9	Silent signaling device (LED Indicator)	1	pc/s
2.2.10	Buzzer with emergency button	1	set/s
2.2.11	Motion detection light	1	set/s
2.3	<b>Wires and cables</b>		
2.3.1	Cat5e UTP cable 4 pairs (305m/box)	1	box/es
2.3.2	#12 AWG stranded THHN wire	20	m
2.3.3	#16 2C AWG stranded TF wire	20	m
2.3.4	#22 2C AWG stranded TF wire	300	m
2.4	<b>Conduits and fittings</b>		
2.4.1	25mm dia PVC pipe (3m/pc) with adapter and locknut	110	set/s
2.4.2	20mm dia flexible PVC pipe (50m/roll)	1	roll/s
2.4.3	20mm dia straight connector	5	pc/s
2.4.4	20mm dia angle connector	5	pc/s
2.5	<b>Boxes</b>		
2.5.1	Junction box with cover (PVC)	20	set/s
2.5.2	Utility box (PVC)	30	pc/s
2.6	<b>Other accessories</b>		
2.6.1	Hanger and support	1	lot
2.6.2	Consumables (tape, tagging, PVC cement and accessories)	1	lot
2.6.3	Mounting termination, testing, commissioning and programming	1	lot



**NOTES**

PROVIDE 15M ALLOWANCE FOR ADDITIONAL/ REDUCTION SECURITY DEVICES BASED ON ACTUAL SECURITY ASSESSMENT


DURING TURN OVER

SUPPLY ALL SAMPLES FOR APPROVAL OF DDP NO PURCHASE & INSTALLATION TO BE DONE W/O DDP'S APPROVAL

WRITTEN DIMENSIONS ON THESE DRAWINGS SHALL HAVE PRECEDENCE OVER SCALED DIMENSIONS

CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS ON THE JOB

DISCREPANCIES BETWEEN DRAWINGS AND ACTUAL CONDITIONS MUST BE IMMEDIATELY FORM ADDED TO CPND FOR RESOLUTION

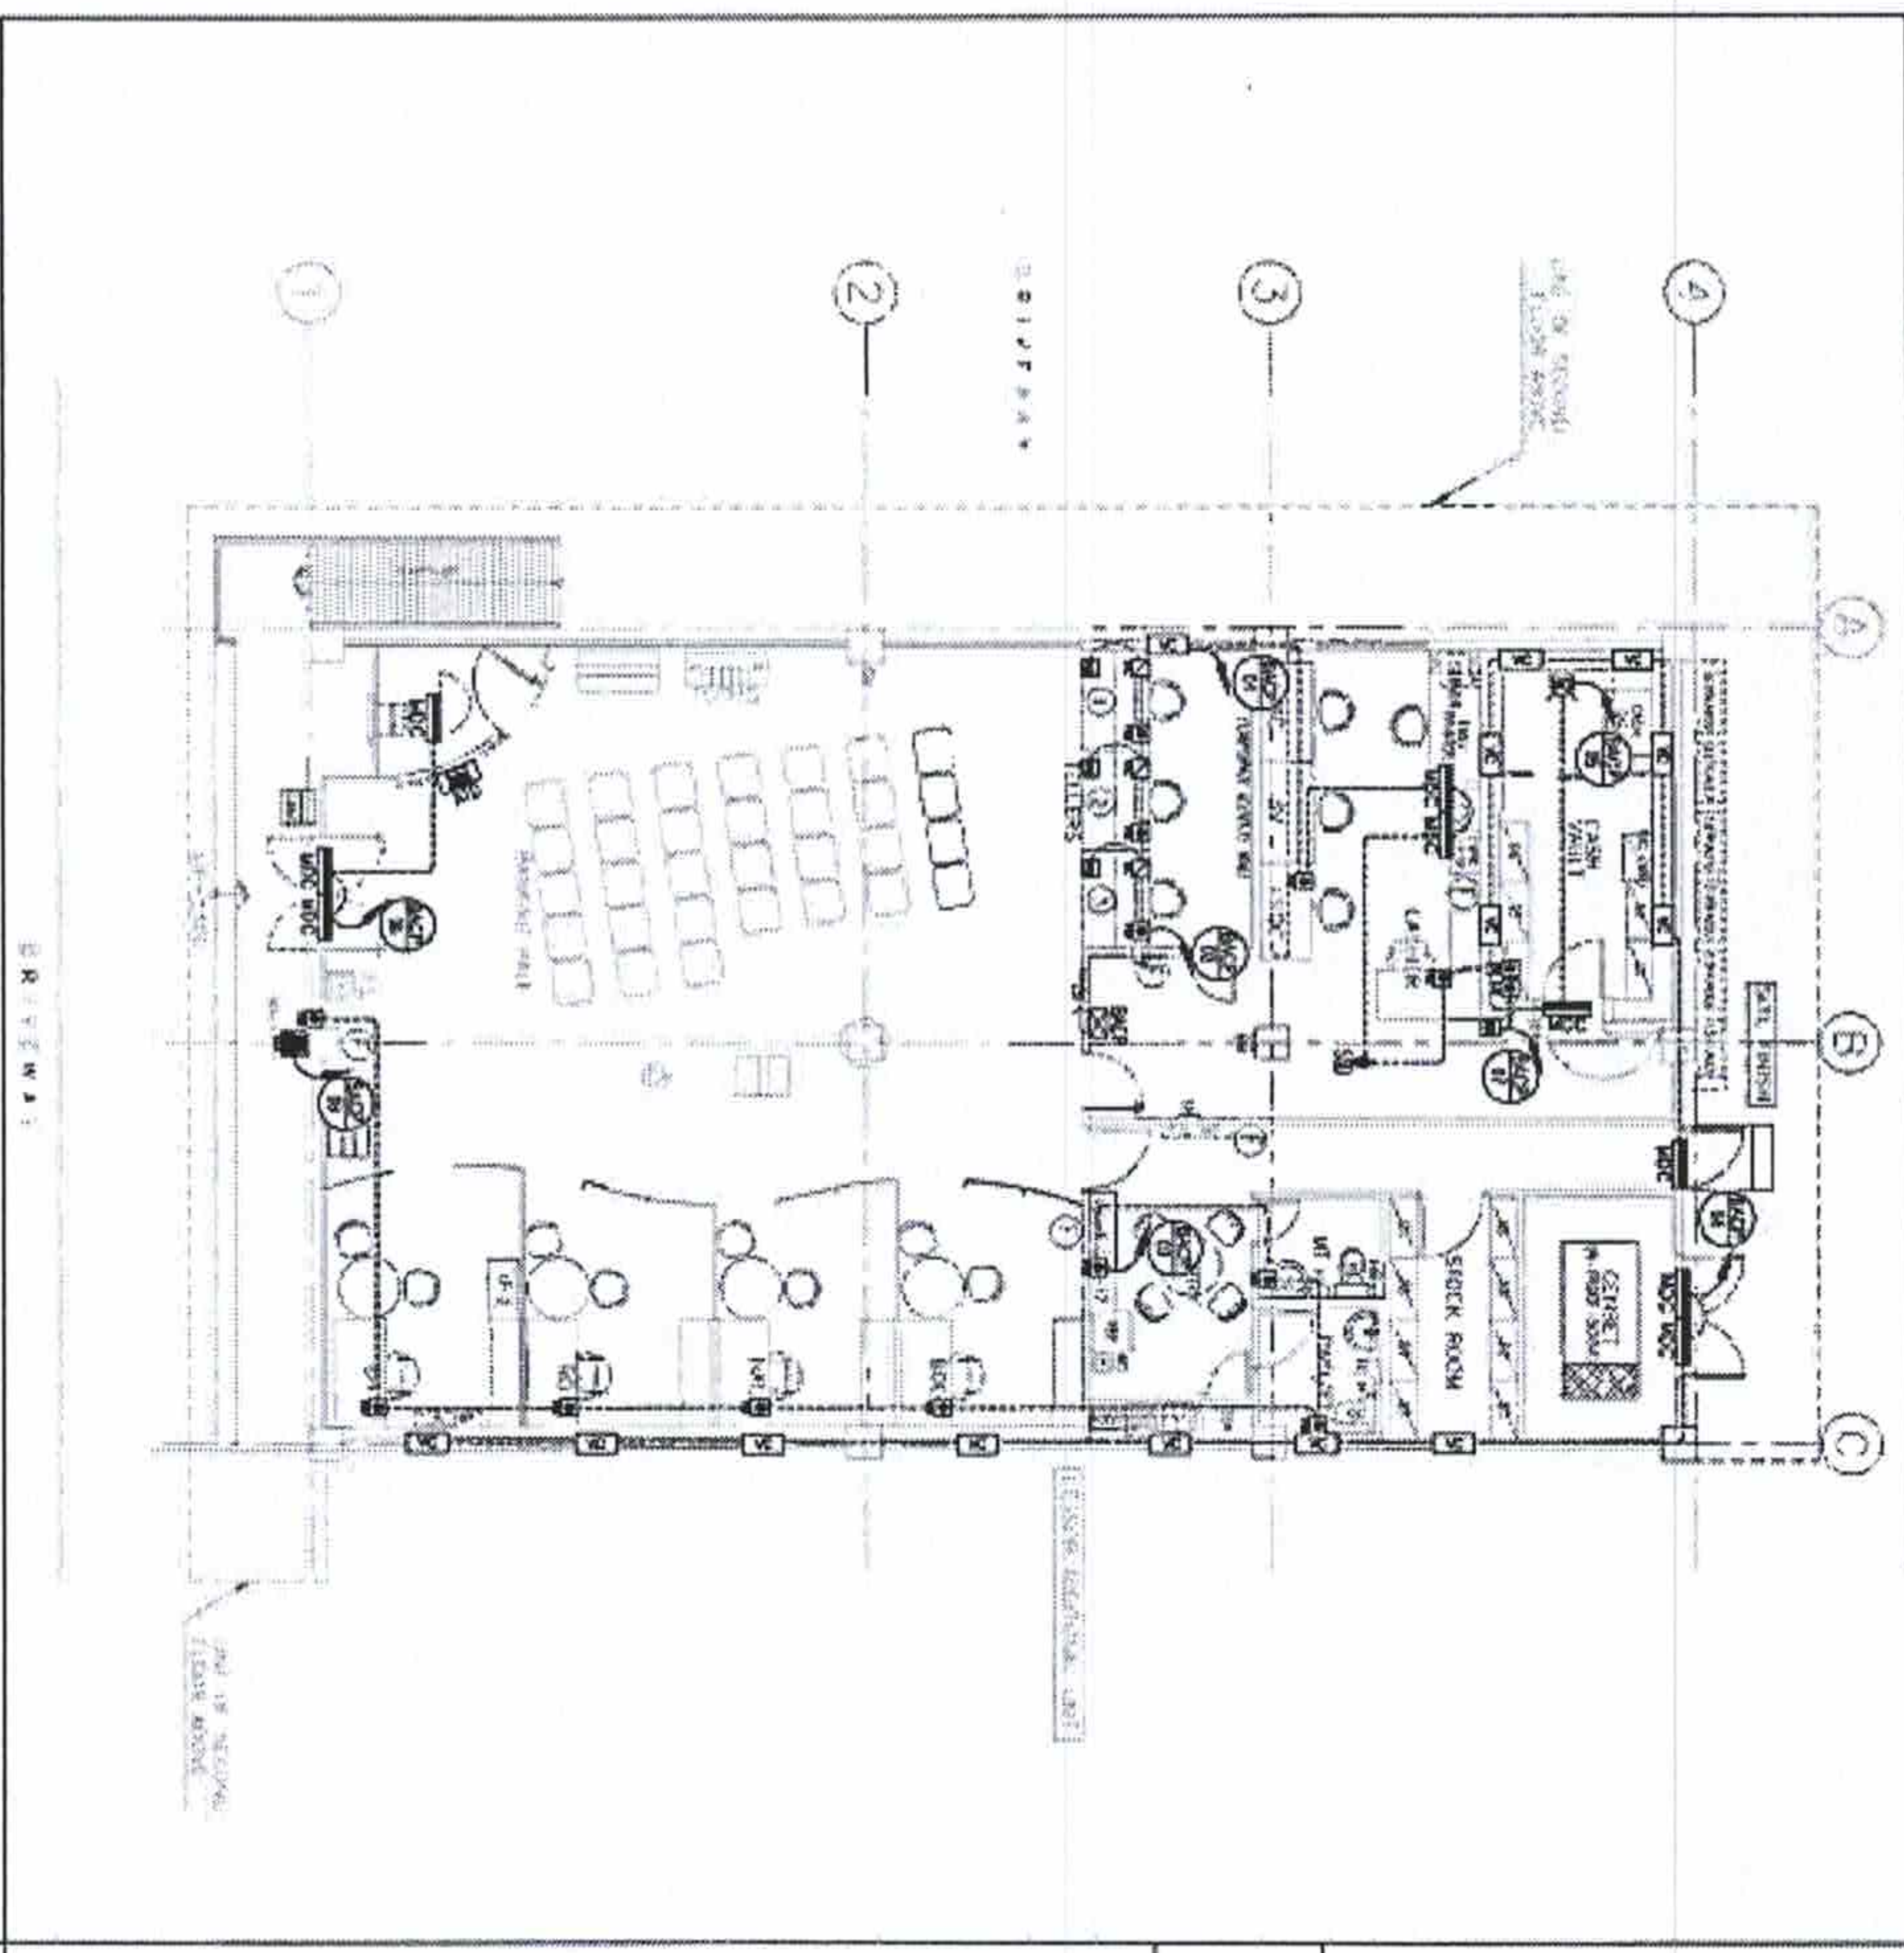

**1**

**BURGLAR ALARM SYSTEM LAYOUT**


SCALE 1:500

NTS

<b>DDBP</b>	PROJECT TITLE:	280N.Y. DEPT. OF CORRECTIONS (DCC) - 1300 W. 130TH ST. - 130TH ST. - 130TH ST. - 130TH ST.
	LOCATION:	280N.Y. DEPT. OF CORRECTIONS (DCC) - 1300 W. 130TH ST. - 130TH ST. - 130TH ST. - 130TH ST.

**LEGEND:**

	BURGLAR ALARM CONTROL PANEL (BACP)		BURGLAR ALARM RISER (BAR)		BURGLAR ALARM RISER CONTROL PANEL (BARCP)
	BURGLAR ALARM RISER CONTROL PANEL (BARCP)		BURGLAR ALARM RISER CONTROL PANEL (BARCP)		BURGLAR ALARM RISER CONTROL PANEL (BARCP)
	BURGLAR ALARM RISER CONTROL PANEL (BARCP)		BURGLAR ALARM RISER CONTROL PANEL (BARCP)		BURGLAR ALARM RISER CONTROL PANEL (BARCP)
	BURGLAR ALARM RISER CONTROL PANEL (BARCP)		BURGLAR ALARM RISER CONTROL PANEL (BARCP)		BURGLAR ALARM RISER CONTROL PANEL (BARCP)
	BURGLAR ALARM RISER CONTROL PANEL (BARCP)		BURGLAR ALARM RISER CONTROL PANEL (BARCP)		BURGLAR ALARM RISER CONTROL PANEL (BARCP)

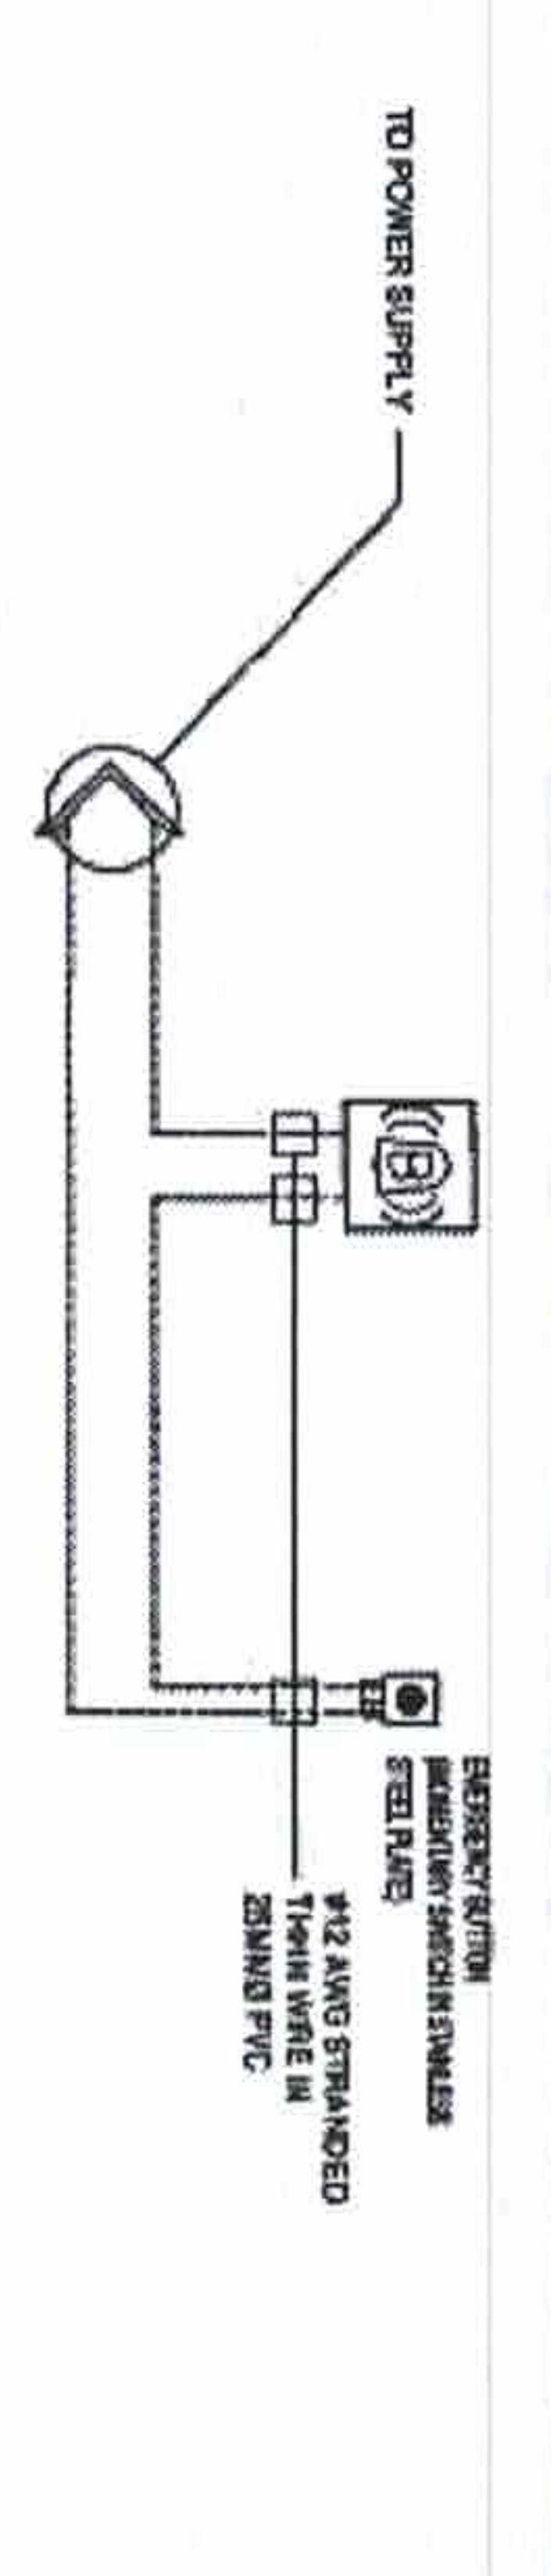


**2**

**EMERGENCY BUZZER RISER DIAGRAM**

SCALE 1:500

NTS

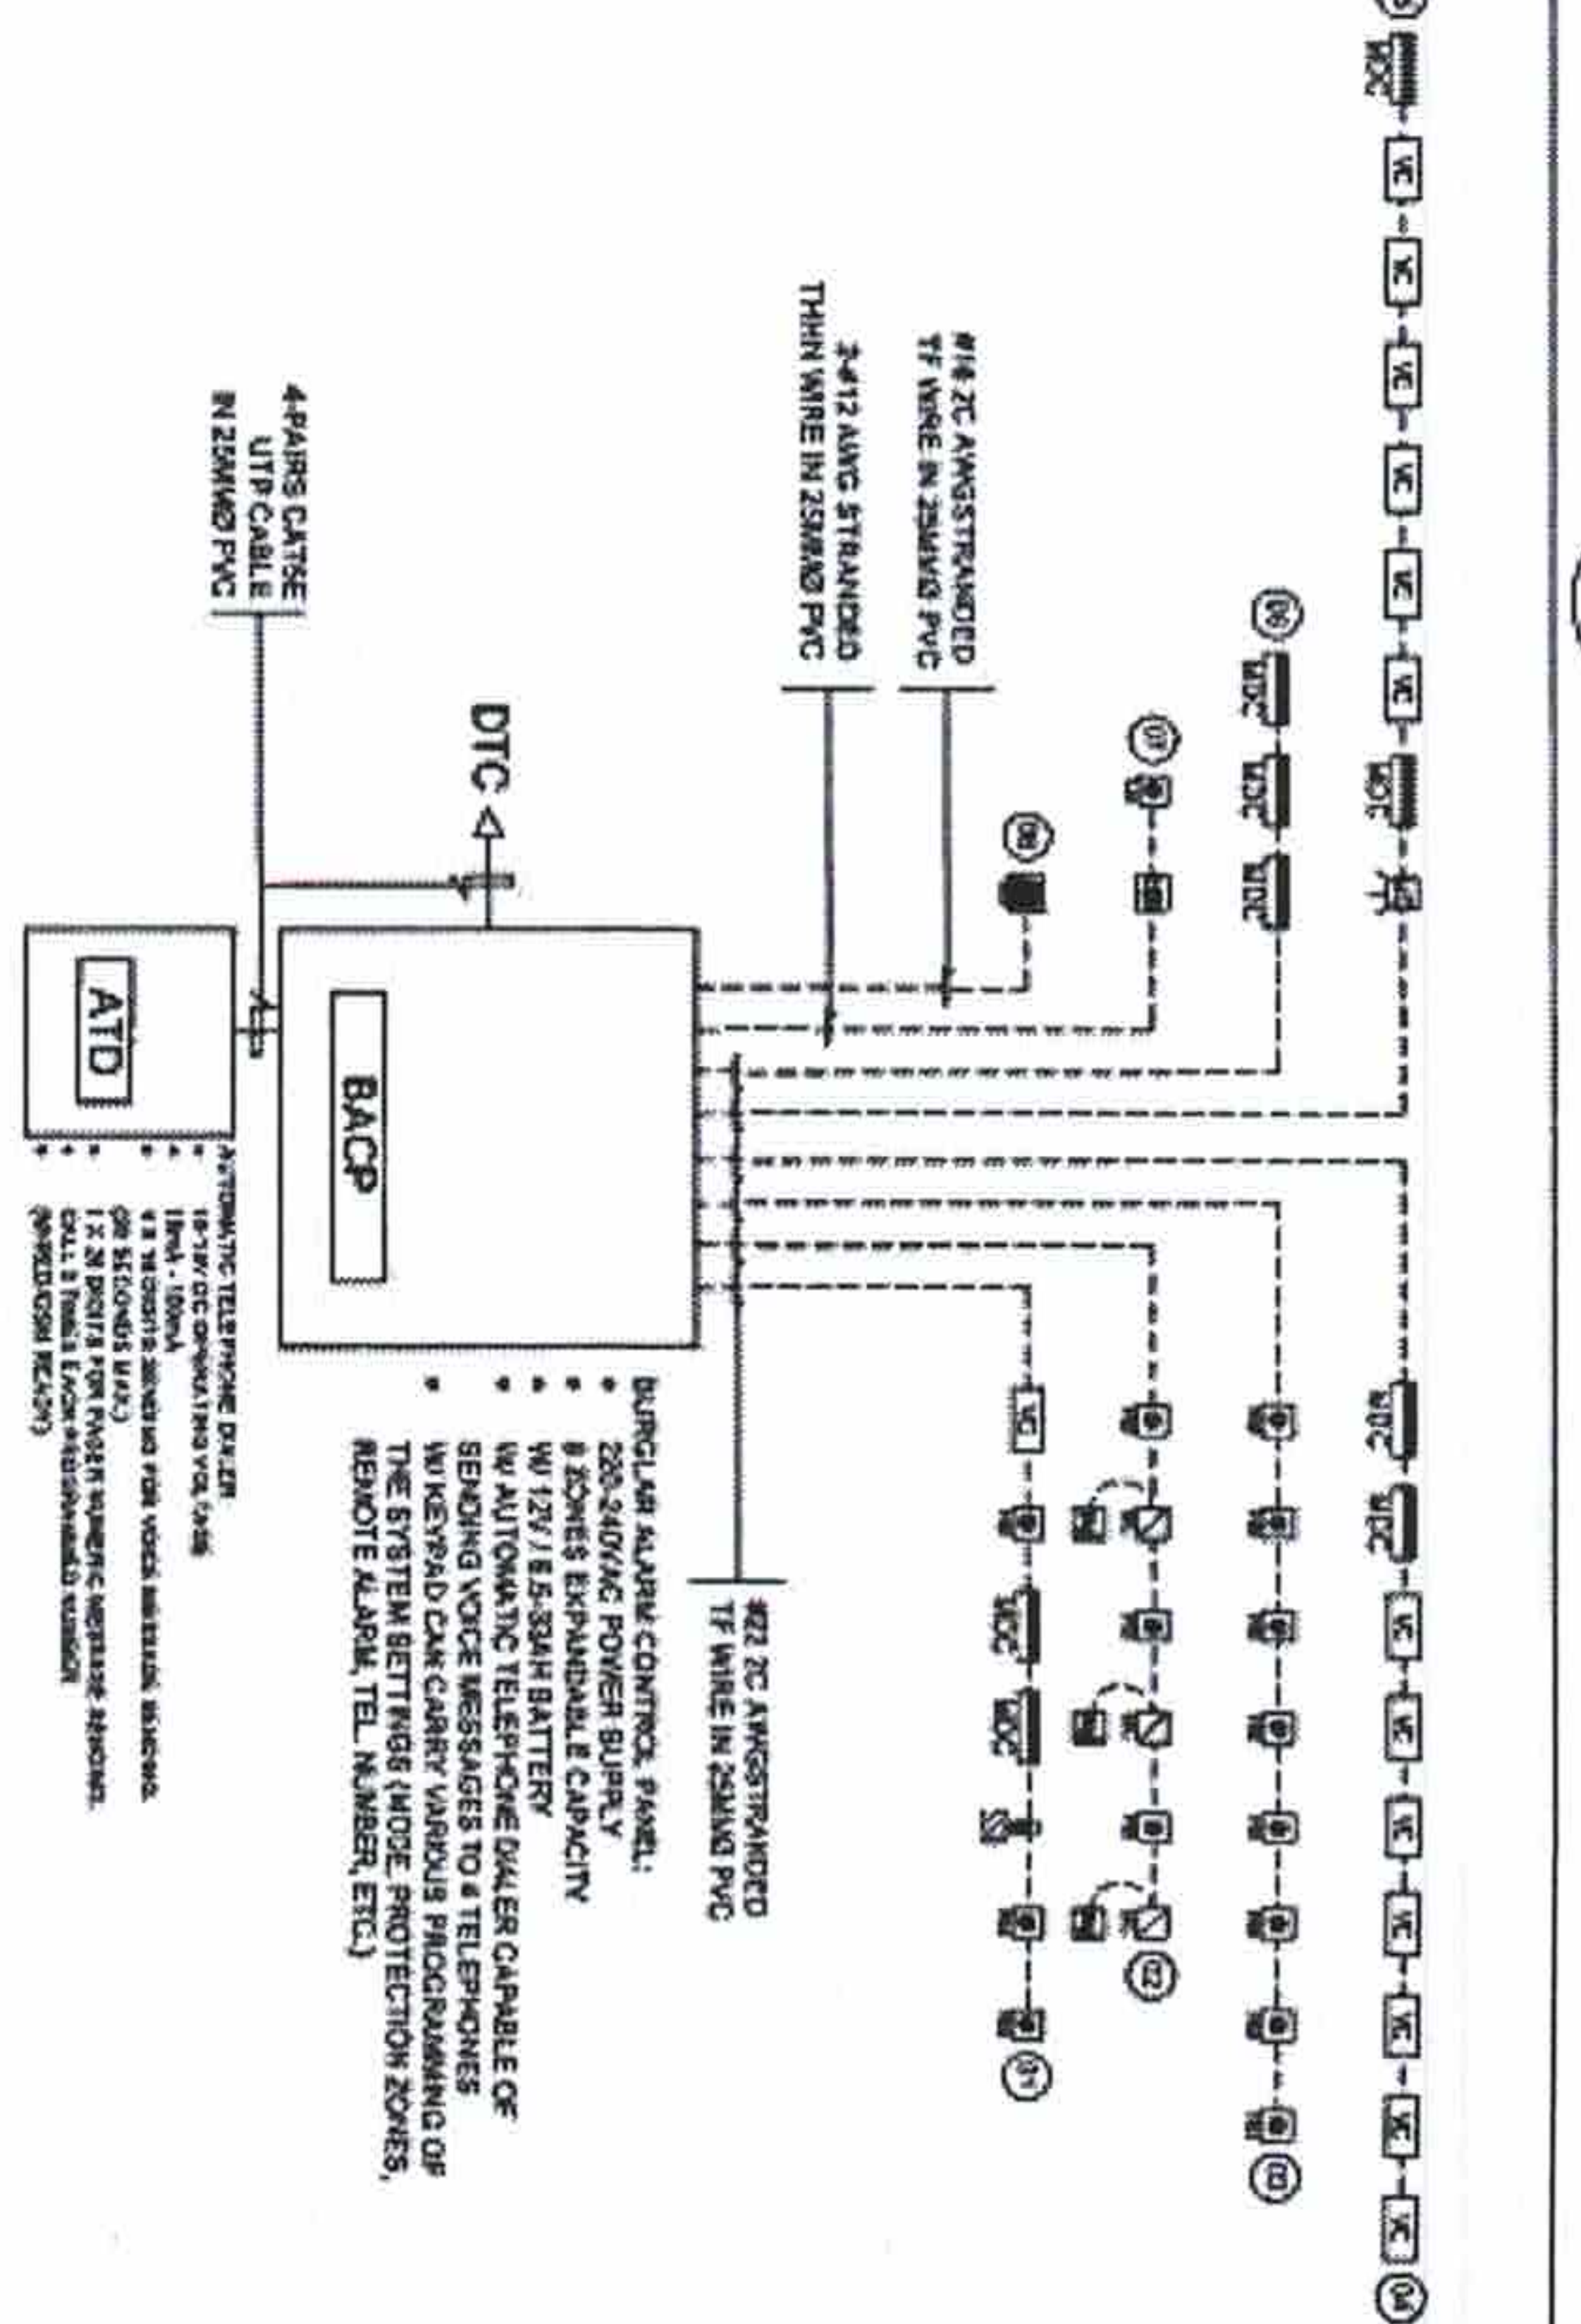

**3**

**BURGLAR ALARM RISER DIAGRAM**

SCALE 1:500

NTS

DESIGNED FOR APPROVAL BY:	APPROVED BY:	REVIEWED BY:	DATE:
<b>- SIGNED -</b>	<b>- SIGNED -</b>	<b>- SIGNED -</b>	
DESIGNED BY:	APPROVED BY:	REVIEWED BY:	DATE:
<b>- SIGNED -</b>	<b>- SIGNED -</b>	<b>- SIGNED -</b>	

**ECE-2**



NOTES:

- PROVIDE 15M ALLOWANCE FOR ADDITIONAL/ RELOCATION SECURITY DEVICES BASED ON ACTUAL SECURITY INSPECTION DURING TURN-OVER.
- SUBMIT ALL SAMPLES FOR APPROVAL OF DBP. NO PURCHASE & INSTALLATION TO BE DONE W/O DBP'S APPROVAL
- WRITTEN DIMENSIONS ON THESE DRAWINGS SHALL HAVE PRECEDENCE OVER SCALED DIMENSIONS.
- CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS ON THE JOB.
- DISCREPANCIES BETWEEN DRAWINGS AND ACTUAL CONDITION MUST BE IMMEDIATELY FORWARDED TO CFMD FOR RESOLUTION.

